


INSTALLATION, OPERATION & MAINTENANCE GUIDE

STYLE 79

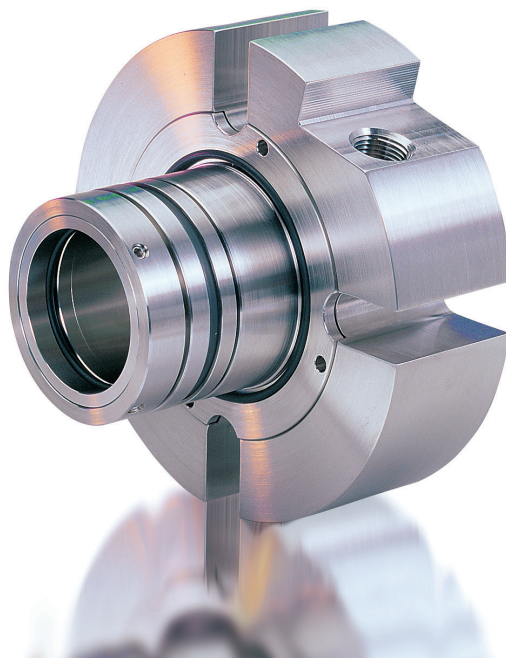

INTERNATIONAL HEADQUARTERS

291 Hurricane Lane
Williston, VT 05495

TEL: (802) 878-8307
FAX: (802) 878-2479

BRAZIL

Rua Javaés, 441/443
Bom Retiro, Sao Paulo
Brazil CEP 01130-010

TEL: 55-11-3736-7373
FAX: 55-11-3736-7355

SOUTHERN USA REPAIR & SERVICE

1719 South Sonny Avenue
Gonzales, LA 70737

TEL: (225) 484-0007
FAX: (225) 341-8922

REVISED: October 2019



OVERVIEW

This guide outlines the installation, operation and maintenance of the Flex-A-Seal Style 79 Double Cartridge Seals. The Style 79 is a highly engineered dual/tandem stationary multi-spring cartridge seal with an internal pumping ring. The Style 79 can also be designed to comply with API 682 Standards, giving it the designation Style 79A. This guide, in addition to the manuals provided by the pump manufacturer and the manufacturer of any auxiliary equipment, should be read in its entirety prior to installation.

NOTICE

Flex-A-Seal does not assume responsibility for misuse, or any damages incurred as a result of the misuse of the supplied sealing system. Contact a Flex-A-Seal representative before making any changes to the provided system or design.

WARRANTY

Flex-A-Seal's limited warranty covers material defects and workmanship for its goods and/or services for a period of six (6) months for new items, or three (3) months for repaired items, from the date of their initial use/installation or delivery, whichever occurs first.

SAFETY

1. Read all instructions thoroughly prior to beginning installation. Review engineering prints for special notes and/or instructions.
2. Removal, installation, operation, and maintenance must only be carried out by qualified personnel who have thoroughly read all instructions.
3. The seal must only be used for its intended application. Flex-A-Seal cannot be held liable for use outside the scope of the recommended application.
4. Inspect the replacement seal prior to removal of the old seal or installation of the new seal using the technical information provided in this document. Contact a Flex-A-Seal representative if there are any questions.
5. Follow plant safety regulations and procedures throughout the disassembly/installation process including, but not limited to, the following:
 - Lockout/tagout procedures
 - SDS consultation for any hazardous materials involved
 - Use of proper personal protective equipment
 - Relief of any system pressure and mechanical energy
6. The following symbols have been used throughout the document to highlight important information:



Instructions intended to prevent damage to the seal or equipment.



Mandatory instructions intended to prevent personal injury or extensive damage to equipment.

NOTE: Information to note while installing, or for later use.

Style 79 Maximum Operating Conditions

Temperature	400°F (204°C)
Pressure	Inboard Differential: 400 psi (28 bar) Outboard: 400 psi (17 bar)
Speed	4500 fpm (22 m/s)

NOTE: Maximum temperature, pressure, and speed indicate operating extremes independently and do not imply the seal will function at these extremes at the same time. Contact Flex-A-Seal if in doubt.



PREPARATION



Verify that equipment has been properly shut off and rendered inoperative according to plant safety protocol (e.g. lockout/tagout procedures).

1. Disassemble the pump seal chamber, in accordance with the pump OEM instructions, to expose the existing seal.

NOTE: Document how the seal chamber is disassembled for re-assembly.

2. Carefully remove the existing sealing device, taking care not to damage the shaft.
3. Clean the shaft, shaft sleeve (if present), and seal chamber face of rust, burrs, grit, sharp

edges, and set screw damage using fine emery cloth. Wipe clean.

ATTENTION

Avoid making flat spots or reducing the shaft diameter.

4. If the pump is equipped with a shaft sleeve, verify the condition of its O-ring or gasket and ensure that it is properly located (fully engaged against step/hook/snap ring).
5. Sealing surfaces and the shaft or shaft sleeve must have at least a 63 Ra- μ in surface finish as seen in [Figure 1](#).
6. For ease of installation, the leading edge of the shaft or sleeve should be chamfered as shown in [Figure 1](#) and all parts should be deburred.

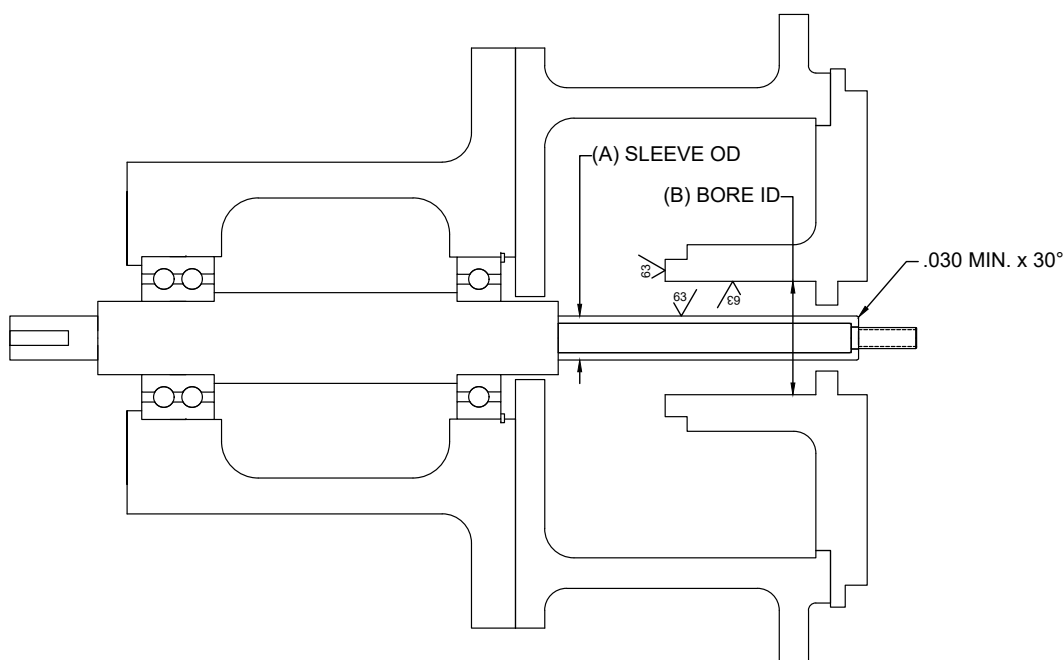


Figure 1: Surface finish and chamfer locations. Fully assembled pump without seal.

VERIFICATION

Successful operation of a Style 79 seal is contingent on conforming equipment dimensions and alignment. Verify the following prior to continuing:

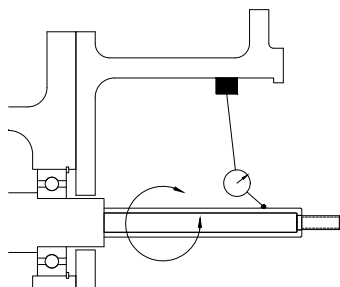


Figure 2: Shaft Runout

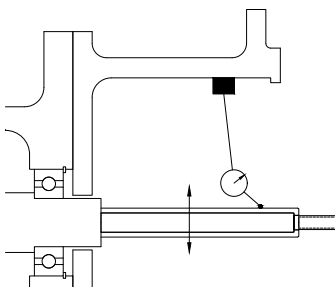


Figure 3: Bearing Fit

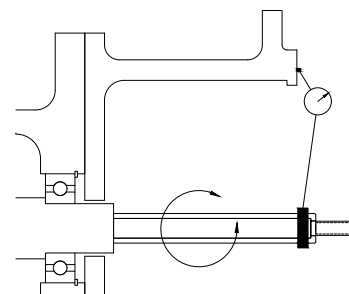


Figure 4: Bearing Frame Perpendicularity

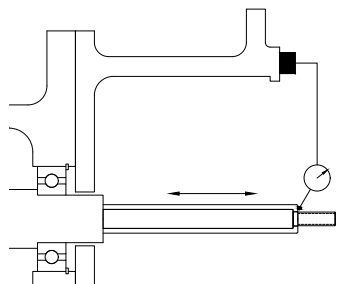


Figure 5: Axial Shaft Movement

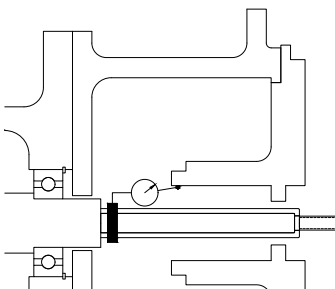


Figure 6: Seal Chamber Bore Concentricity

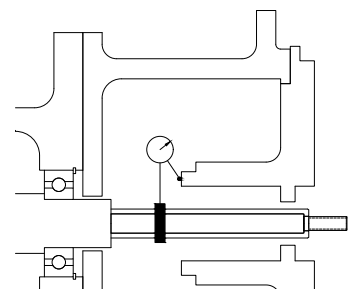


Figure 7: Seal Chamber Face Squareness

Maximum Alignment Variation (TIR)

Fig. 2	Radial shaft movement (shaft runout)	0.0015–0.003 in.
Fig. 3	Radial bearing fit	0.002–0.003 in.
Fig. 4	Bearing frame perpendicularity	0.0005 in./in.
Fig. 5	Axial shaft movement (end play)	0.003 in.
Fig. 6	Seal chamber bore concentricity	0.005 in.
Fig. 7	Seal chamber face squareness	0.0005 in./in.

For proper function and satisfactory operation of the seal it is imperative that connections, dimensions, finishes, and alignments are all acceptable based on the specified design. If measured values exceed the values given above, adjust the equipment to meet the specifications before installing the seal. These values are general guidelines and the pump OEM should be used to verify acceptable values whenever possible.



SEAL INSTALLATION

Style 79 double cartridge seals entail the same simple installation procedure as other Flex-A-Seal cartridge seals. Ensure alignment verification of equipment has been completed prior to starting the installation procedure. Review engineering prints for special notes and/or instructions.

NOTE: It is essential to use a suitable lubricant when installing a seal, as different lubricants will work better with different elastomers.

1. Disassemble the pump until the seal chamber and shaft are accessible.
2. Remove the seal from its packaging and inspect for damage to any components and seal faces.

NOTE: Cartridge seals are shipped from Flex-A-Seal fully assembled and should not be disassembled without cause. If a seal appears damaged prior to installation, contact a Flex-A-Seal representative.



Grease, scratches, or nicks on the seal faces may cause leakage.

3. Ensure the shaft and seal housing have been properly cleaned as described in the

preparation section.

4. Lightly lubricate the seal sleeve O-ring with a suitable and compatible lubricant.
5. Gently slide the seal on the shaft with the gland gasket facing, but clear of the seal chamber.
6. Reassemble the pump as described by the pump OEM.
7. If the gland is equipped with a gland gasket, lubricate gland bolts and bolt the gland to the seal chamber using the Legacy Method (Star Pattern) according to torque values specified in the table below. Be sure not to overtighten the gland bolts as this may distort the gland and internal components resulting in seal leakage.

NOTE: For mechanical seals with a register fit or a metal-to-metal mate with the seal chamber, standard torque-tension specifications for bolts and studs is sufficient.

8. Alternately tighten the provided set screws to the specified torque value according to the table below.
9. Remove the setting clips from the seal. Save these for future use in seal removal or impeller adjustment.

Torque Rating for Cartridge Seal Gland Bolts (Flat Gasketed Gland)

Shaft Size	1.000–2.000 in.	2.125–3.250 in.	3.375–4.000 in.
	24–50 mm	53–80 mm	85–100 mm
Recommended Torque	20 ft-lbs.	25 ft-lbs.	30 ft-lbs.
	27 N-m	34 N-m	41 N-m

Cup Point Set Screw Torque Specifications

Screw Size	Alloy Steel	Stainless	Screw Size	Alloy Steel	Stainless
#10	36 in.-lbs.	26 in.-lbs.	M4	2.0 N-m	1.5 N-m
1/4	87 in.-lbs.	70 in.-lbs.	M6	7.9 N-m	6.1 N-m
5/16	165 in.-lbs.	130 in.-lbs.	M8	19.6 N-m	15.4 N-m
3/8	290 in.-lbs.	230 in.-lbs.	M10	37.0 N-m	29.5 N-m
1/2	620 in.-lbs.	500 in.-lbs.	M12	60.3 N-m	48.3 N-m

SEAL SUPPORT SYSTEM INSTALLATION

The following steps briefly describe the methods in which a buffer/barrier system should be piped and set up to support a double cartridge seal. Consult Flex-A-Seal for specific applications and details.

1. Correctly make connections between the buffer/barrier fluid system and the mechanical seal according to the connection labels on the prints. In the case of a Piping Plan 52 or Plan 53A the SEAL SUPPLY connection (lower port) on the reservoir must lead to the buffer/barrier fluid in (BFI) connection on the seal gland; the SEAL RETURN connection (upper port) on the reservoir must lead to the buffer/barrier fluid out (BFO) connection on the seal gland ([Figure 8](#)).
 - Piping should slope continuously upwards ($\frac{1}{2}$ in./ft. [40 mm/m] minimum) with no relative high points that would result in trapped air in the tubing.
 - For shafts smaller than 2 $\frac{1}{2}$ in. [64 mm] use at least $\frac{1}{2}$ in. diameter tubing and at least $\frac{3}{4}$ in. tubing for larger shafts.
 - Use smooth, long radius bends in the piping, minimize 90° elbows, and use 45° bends wherever possible.

ATTENTION

Use thread sealant instead of thread tape. Thread tape has been known to break apart and enter the buffer/barrier fluid stream, resulting in damage to and premature failure of the mechanical seal.

ATTENTION

Ensure that all tubing/piping is free of pipe strain, which can adversely affect the seal.

2. Flood the seal support system with the recommended buffer/barrier fluid and ensure all air is properly vented from the seal.
3. Check for seal leakage.

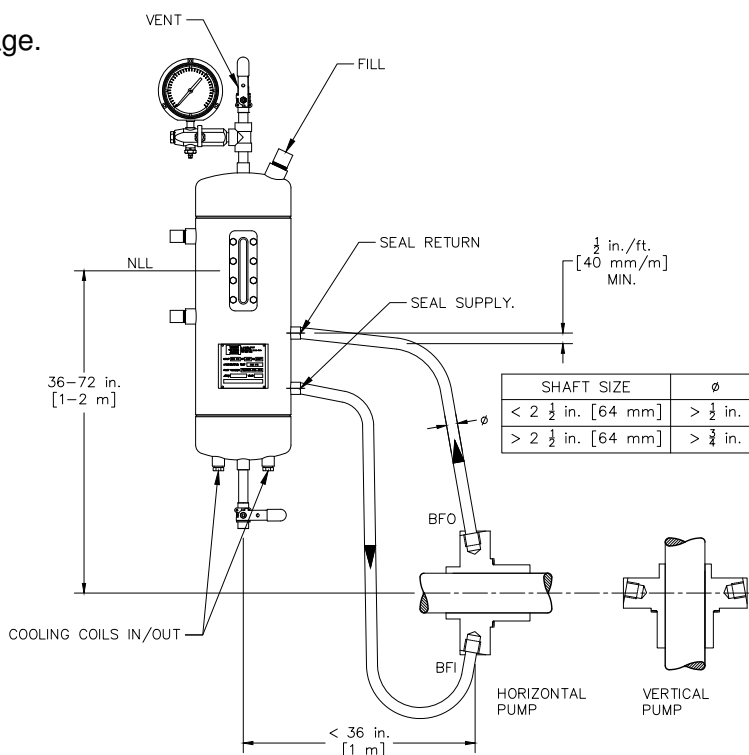


Figure 8: Typical installation of a buffer/barrier fluid reservoir.



BEFORE STARTING THE EQUIPMENT

1. Ensure the pump shaft is properly aligned at the coupling with the motor.
2. Check that all gland plate bolts and all screws are securely fastened.
3. Once the pump is reassembled, turn the shaft by hand if possible to check for free rotation, if not, recheck installation.
4. Verify that all plumbing and piping plans for the seal are connected and configured according to best practice.
5. Flood the pump, vent all air from the seal chamber, and again check seal for leakage. Ensure the product is not leaking into the seal support system by noting changes in liquid level and buffer/barrier fluid pressure.
6. Ensure all plumbing and venting for the seal and seal support system are free of obstruction and that the chamber is filled with liquid. Check that all alarms connected to auxiliary systems are properly functioning to alert personnel if any issues arise.
7. Start the pump per the pump manufacturer's recommendations, observe for proper operation, and check for excessive heat at the seal gland.

ATTENTION

Dry-running is a major cause for leakage and/or failure of mechanical seals. It is imperative that the seal chamber be completely vented prior to startup and that adequate lubrication is supplied to the seal.

ATTENTION

Check periodically during operation to ensure that the seal is not overheating.

OPERATION & MAINTENANCE

If leakage is detected, it should be addressed as soon as possible to prevent hazards and protect personnel. Leakage could come from a number of leak paths in the seal, or be caused by changes in the pump operation or condition. Although seals should be inspected regularly for signs of leakage, a properly selected and functioning mechanical seal will run for extended durations without need for extra attention and should not be disturbed unnecessarily (i.e. shut down and disassembled without cause). Below is an inexhaustive list of possible causes of leakage.

Primary Causes

- Worn seal faces
- Damaged O-rings
- Damaged springs

Secondary Causes

- Change in duty conditions
- Dry-running
- Worn bearings
- Increased vibration

It is important to periodically inspect and maintain flush systems, shaft alignment, and consistent duty parameters to ensure the seal performs as designed. Often, there is a case of cause & effect with machinery and processing issues upstream that can cause a seal to leak. Check for the root cause of leakage when disassembling equipment for inspection or service.

Buffer/barrier fluids will break down over time or become contaminated with process leakage. Fluids should be drained from the system as often as possible or during scheduled pump shutdowns. The reservoir and tubing/piping should be flushed and filled with new, clean buffer/barrier fluid. It is important to clean the seal support system after a seal failure; the cleaning fluid and procedure required will depend on the contamination in the reservoir. Never re-use barrier fluid after a seal failure.



DECOMMISSIONING EQUIPMENT

When decommissioning equipment it is important to ensure that the pump has been fully isolated from the process and power sources for personnel safety. Pressure and fluid should be fully released before disassembly of the equipment is to begin.



If the equipment has been used with toxic or hazardous fluids, ensure that it is decontaminated and neutralized before decommission begins. There is often residual fluid remaining from the draining process so consult the pump OEM for special cases.

REMOVING THE SEAL



Before opening the pump to remove the seal the warning stated above regarding toxins and hazardous products must be reiterated. Make note of all fluids contained in the pump, drain and decontaminate before opening the housing for seal service.

1. Ensure all fluid has been drained and vented from both the pump and seal support system. Equipment should be shut down and locked/tagged out according to OEM and plant specifications.
2. Dismantle equipment sufficiently so that the gland plate and seal housing are exposed and accessible for service. Disconnect the seal support system piping from the mechanical seal.
3. Reset the setting clips that were saved from installation.
4. Back-out the cup point set screws.
5. Remove the gland bolts/nuts in an even manner.
6. Carefully slide the seal out and off of the shaft.



If a part is going to be returned for service or to any third party, all shipments should have appropriate safe-handling instructions securely attached to the package.

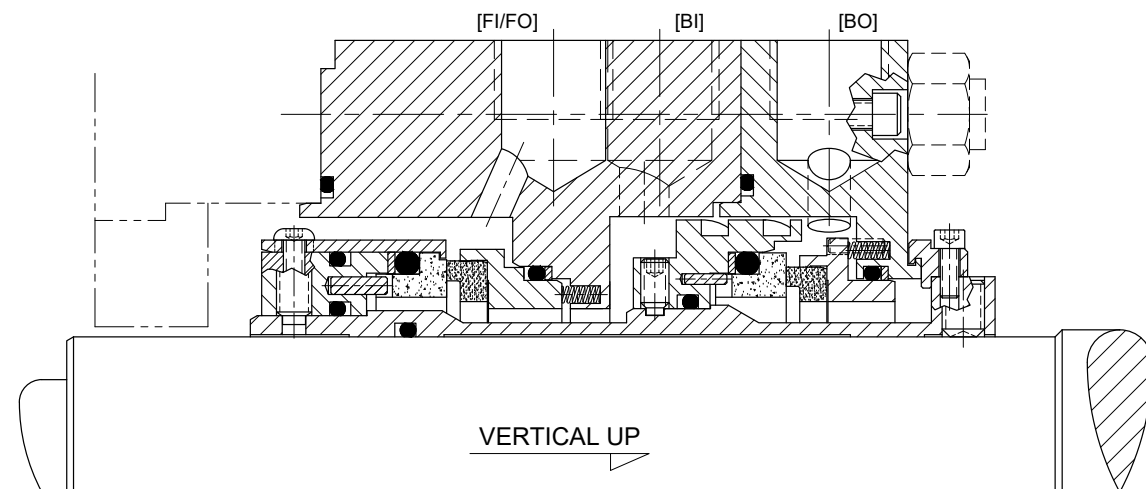


Figure 9: Vertically oriented Style 79 layout with axial pumping ring